


Introduction:


In order to provide for fire resistance to fire from both above and below a self-supporting membrane ceiling, a facing board of SUPALUX® is normally required on both the upper and lower surfaces as shown in the illustration on the right.

However, there are situations where installing the upper facing sheet is impossible due to inadequate access or where access is only possible from below. Such situations may be found for example at the head of protected shafts, or to the underside of steel stair cases.

In these situations, the inability to install the upper facing sheet is compensated by an increase in the minimum requirement of the rock wool insulation layer as detailed below.

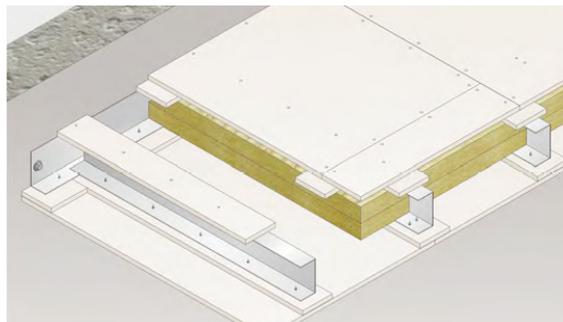

Normal self-supporting ceiling membrane construction where access from above permits a top facing sheet to be installed

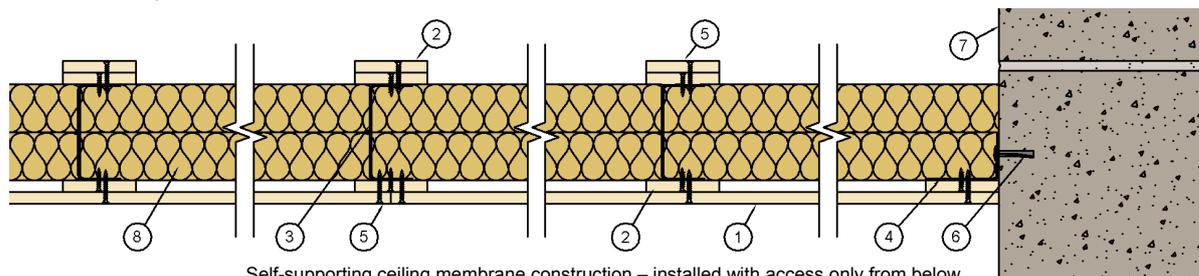

Construction:

The following construction may be used to provide 60 minutes fire integrity and insulation in accordance with the criteria of BS 476: Part 22: 1987 to fire from above or below.

1. Promat SUPALUX® boards, 9mm thick (square edged).
2. Promat SUPALUX® fillets, 75mm x 9mm thick.
The thickness of Promat SUPALUX® fillets on underside of the perimeter angles may be reduced by 3mm to maintain an even surface for the main ceiling boards.
Lateral board joints backed by Promat SUPALUX® fillet fastened using M4 x 25mm long self-tapping screws at nominal 200mm centres on both sides of the joint.
3. C-channel purlins (see table to right) positioned at maximum 610mm centres. Expansion gap is left at both ends of the C-channels.
4. Perimeter steel angle, nominally 75mm x 50mm, fastened to wall around perimeter of ceiling, through the 50mm leg, with minimum M6 x 50mm long all steel fixing anchors at 300mm nominal centres. See table for angle thickness.
5. M4 x 38mm long self-tapping screws fixed at 200mm centres on facing board and M4 x 25mm long self-tapping screws at 500mm centres on coverstrip to purlins.
6. M6 x 50mm long steel expansion bolts at 300mm centres.
7. Concrete or brickwall.
8. Rock wool, minimum 2 x 50mm x 60kg/m³ joints staggered by 300mm between layers.
Note: ceiling spans of 3m and over require the three layers of rock wool to ensure that the full depth of the channel is in-filled.

Ceiling span (m)	C Channel purlin (mm)	Perimeter angle thickness (mm)	Expansion gap at each end (mm)
Up to 1.6	100x44x1.0	1.0	12
1.8	100x44x1.0	2.0	12
2.0	100x44x1.0	2.0	12
2.2	100x44x1.0	2.0	15
2.4	100x44x1.2	2.0	15
2.6	100x44x1.6	2.0	15
2.8	100x44x1.9	2.0	18
3.0	150x44x1.2	2.0	18
3.2	150x44x1.2	3.0	18
3.4	150x44x1.6	3.0	23
3.6	150x44x1.6	3.0	23
3.8	150x44x1.9	3.0	23
4.0	150x44x1.9	3.0	23

AUTHORITY: Promat Recommendation - Based on in-house knowledge and Technical Experience

Technical Data Sheet – 110

Page 1 of 1
(April 2009)



Promat UK Limited
 Technical Services Department
 The Sterling Centre, Eastern Road
 Bracknell, Berkshire RG12 2TD
 Tel: 01344 381 400
 Fax: 01344 381 401
 E-mail: technicaluk@promat.co.uk

